

# Annexure C

## PROFORMA FOR SAFE DRINKING WATER AND SANITARY CONDITION CERTIFICATE

No.

Dated:

It is certified that an inspection team headed by P.H.E.D. Sub. Division KUKSHI  
(Name of Officers with designation) from Assistant Engineer PHED

inspected the PERFECT ACADEMY KUKSHI DIST. DHAR M.P.

(Name & Address of the school) on 10-05-25 (date of inspection) and on the basis of

Water Test Report (Attached) bearing no. 80 dated 13-05-25

of PHED KUKSHI (PHED Lab) certified that the

PERFECT ACADEMY KUKSHI DIST. DHAR M.P. (Name of school) has safe drinking water facilities for the students and members of staff of the institution. School is also maintains the hygienic sanitation condition in the school building & the campus as per norms prescribed by the Central/ State/ U.T. Govt.

This certificate is valid till 01 year from the

Date of Certificate

Signature with Seal: Assistant Engineer  
Name : PHED Sub-Division Kukshi  
Designation :  
Name & Address of the Office/Department: .....

To  
Principal / Manager  
Perfect Academy Kukshi  
Dist. Dhar M.P.  
(Name & Address of the Institution)

Note: The certificate is to be issued by authorized officer/PHED Lab/local bodies

Sub Division Laboratory Kukshi  
Public Health Engineering Department Kukshi

**ANALYSIS REPORT**

Type of sample :- Tubwell

PARTICULARS OF SENDER :- AE PHED SUB DIVISION KUKSHI

PARTICULARS OF SENDER Collected/Not Collected by PHED

Samle	Place of collection	Date
1	PERFECT ACADEMY KUKSHI ( Shidharth Nager Full ke Purve me )	13-05-2025

**PARTICULARS TO BE FILLED IN THE LABORATORY**

Date of Receipt :- 13.05.2025	Time of Receipt : 3.20 PM
Lab referece No. 80	Tested On. 13-05-2025

**NATURE OF STUDY - CHEMICAL & BACTERIOLOGICAL ANALYSIS**

No.	Characteristic	Unit	As Per BIS - 10500:2012		Results			
			For Drinking water		Sample 1	Sample 2	Sample 3	Sample 4
			Requirement ( Desirable Limit)	Permissibile Limit				

**PHYSICAL TESTS**

1	Temperature	C	-	-	-				
2	Turbidity	NTU	1	5-0	1.8				
3	Colour	Hazen	5	15	-				
4	Odour	-	Unobjectionable	Objectionable					

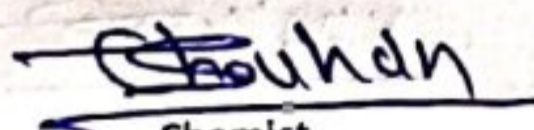
**CHEMICAL TESTS**


	pH	ph Scale	6.5-8.5	No Relaxation	7.51				
5	Total Alkalinity	mg/l	200	600	260				
6	Total Hardness	mg/l	200	600	300				
7	Calcium	mg/l	75	200	70.4				
8	Megnesium	mg/l	30	100	29.7				
9	Chloride	mg/l	250	1000	100				
10	Sulphate	mg/l	200	400	125				
11	Nitrate	mg/l	45	45	0				
12	TDS	mg/l	500	2000	741.6				
13	Iron	mg/l	0.3	1	0.1				
14	Manganese	mg/l	0.1	0.3	0				
15	Fluoride	mg/l	0.1	1.5	0.1				
16	Residual Chlorine	mg/l	0.2	1	0				

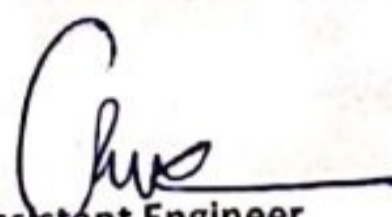
**BACTERIOLOGICAL TESTS**

17	M.PN of Coliform	Pre 100ml	Nill		0				
18	Faecel Coliform	Pre 100ml	Nill		0				

Findings & Remark :-

  
Chemist  
water Testing Laboratory  
Sub Division Kukshi

  
Lab Incharge  
District/Sub Division Laboratory  
Health Engineering Department

  
Assistant Engineer  
P.H.E Sub Division  
Kukshi